


IMPORTANT NOTE: The controller board used in this Equipment Module has been modified to operate two pumps. When ordering a replacement controller board, please specify "For use with an EM-1000, two pump, electric heater Equipment Module."

PCB MODIFICATION - FACTORY USE ONLY -  
 Configure board for two pumps and move jumper wire on bottom of board from IC4, pin #7 to IC1, pin #10 to convert T-91 ozone relay to second heater relay.

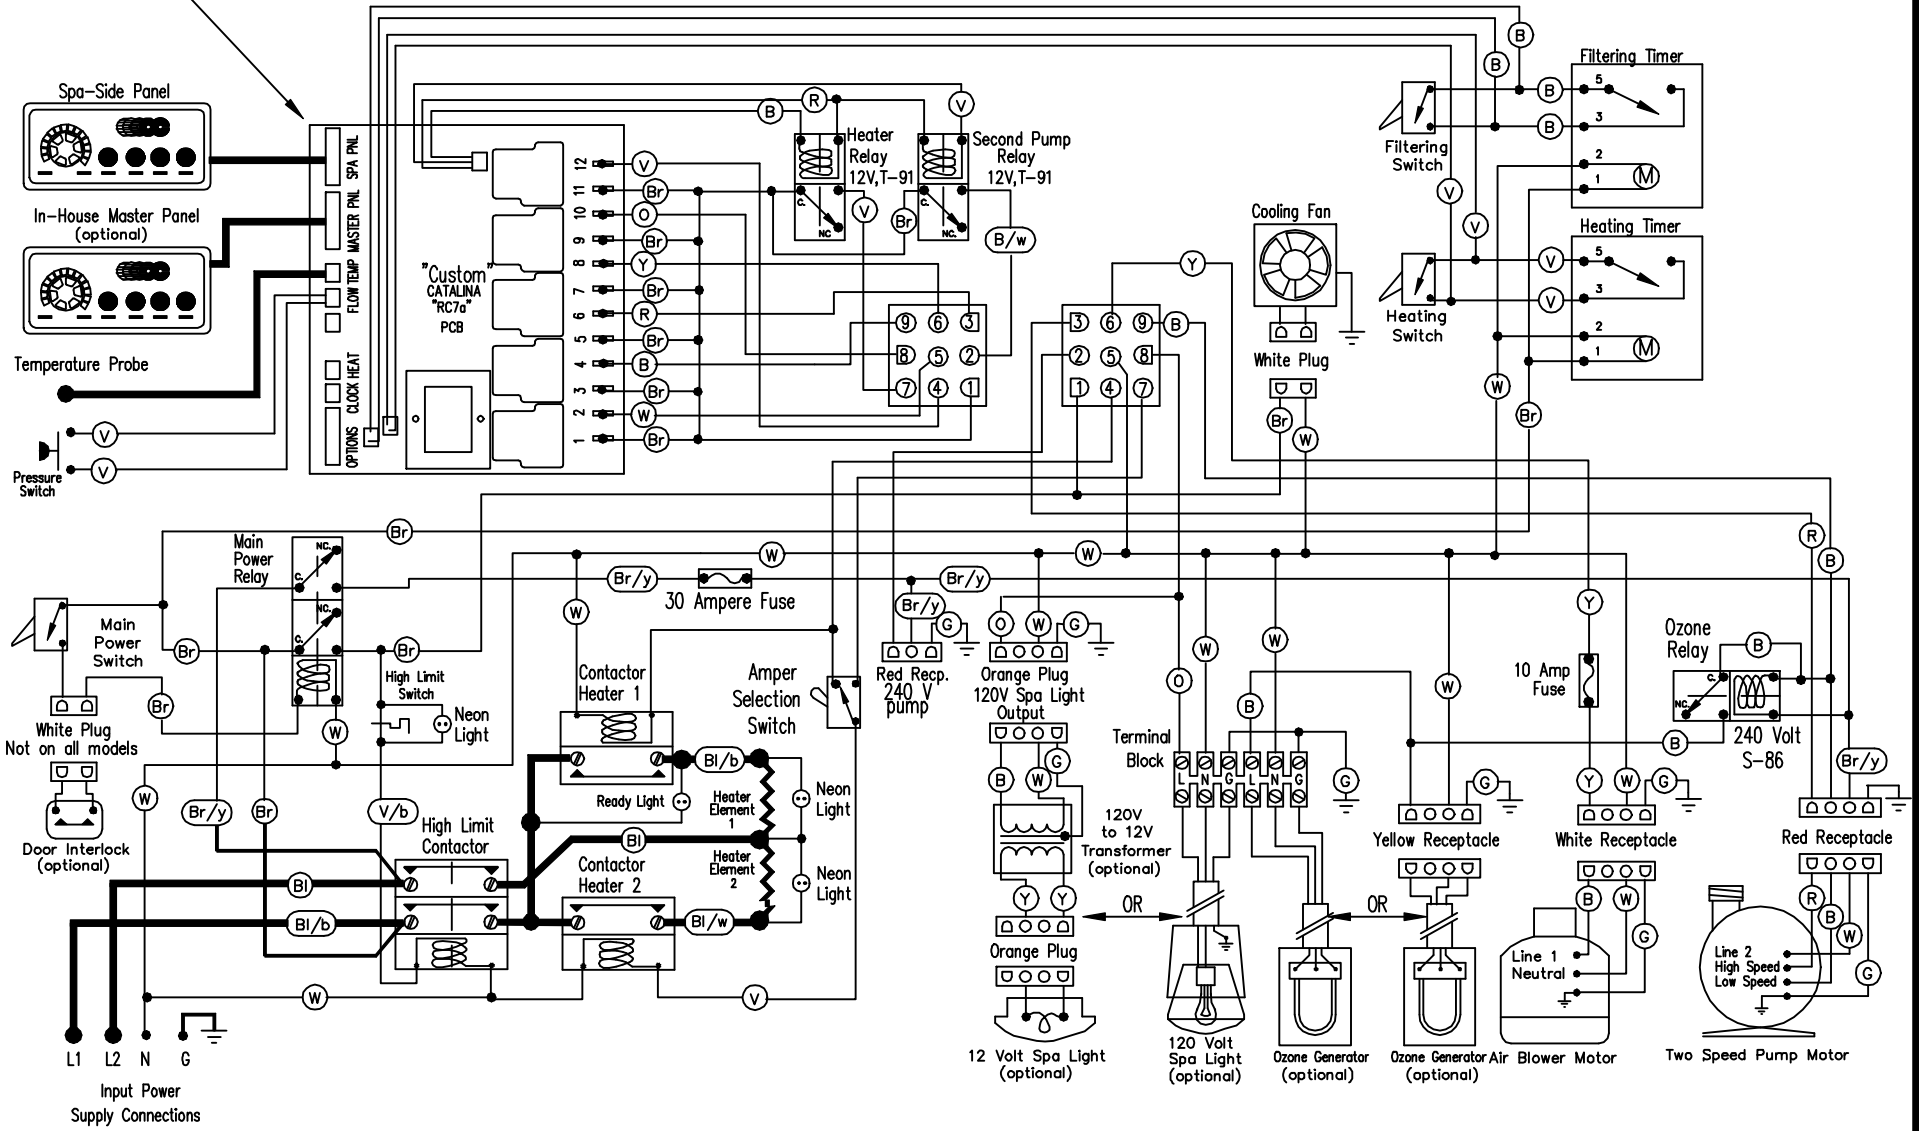

**BRETT AQUALINE, INC.**  
 HUNTINGTON BEACH, CA (714) 891-7211

Notes:

Dwn by G.B. Aprv

Wire Color Code

Catalog Series: **27-0160TC2** May be followed by: **A, D, E, X, or Y** May be followed by: **-A thru -P** Followed by: **S** May be followed by additional suffix letters or numbers

B - Black G - Green  
 Br - Brown Bl - Blue  
 R - Red V - Violet  
 O - Orange Gr - Gray  
 Y - Yellow W - White

Spa Pack Model: EM-1000 Note: 1. Pump & air blower may not be provided by Brett Aqualine 2. Relays & switches shown may actually be single or double pole.

Dwg No: W0105A

Date: 06-19-92 Rev: 0